

Date: July 21, 2022

ASI-12

Project: DelDOT Georgetown Administration Building

Project No: T202180102 SJ Project No: 20069

The work herein shall be considered part of the bid documents for the referenced project and carried out in accordance with the following supplemental instructions issued in accordance with the Contract Documents without change in Contract Sum or Contract Time. Acknowledge receipt of addendum on the bid form as indicated.

Revised Drawings

P-101 and P-103:


- 1. Delete two (2) overflow scupper drains and provide two (2) overflow roof drains as described in attached drawing.
- 2. See attached updated Drawings P-101 and P-103.
- 3. Provide cost proposal for approval.



<u>CONSULTANT</u> THIS DRAWING IS THE PROPERTY OF <u>STUDIOJAE</u>T AND IS PREPARED FOR THE EXCLUSIVE USE OF TS CLIENTS AT THE LOCATION INDICATED. NO OTHER USE IS AUTHORIZED OR INTENDED. ARCHITECT / ENGINEER SEAL REVISIONS Date Description
11/08/2021 Addendum #5 5/25/2022 ASI #8 07/21/2022 ASI-12 SANITARY FLOOR PLAN ISSUED FOR CONSTRUCTION JANUARY 26, 2022

P-101

1 FIRST FLOOR SANITARY PLAN P-101 1/8" = 1'-0"

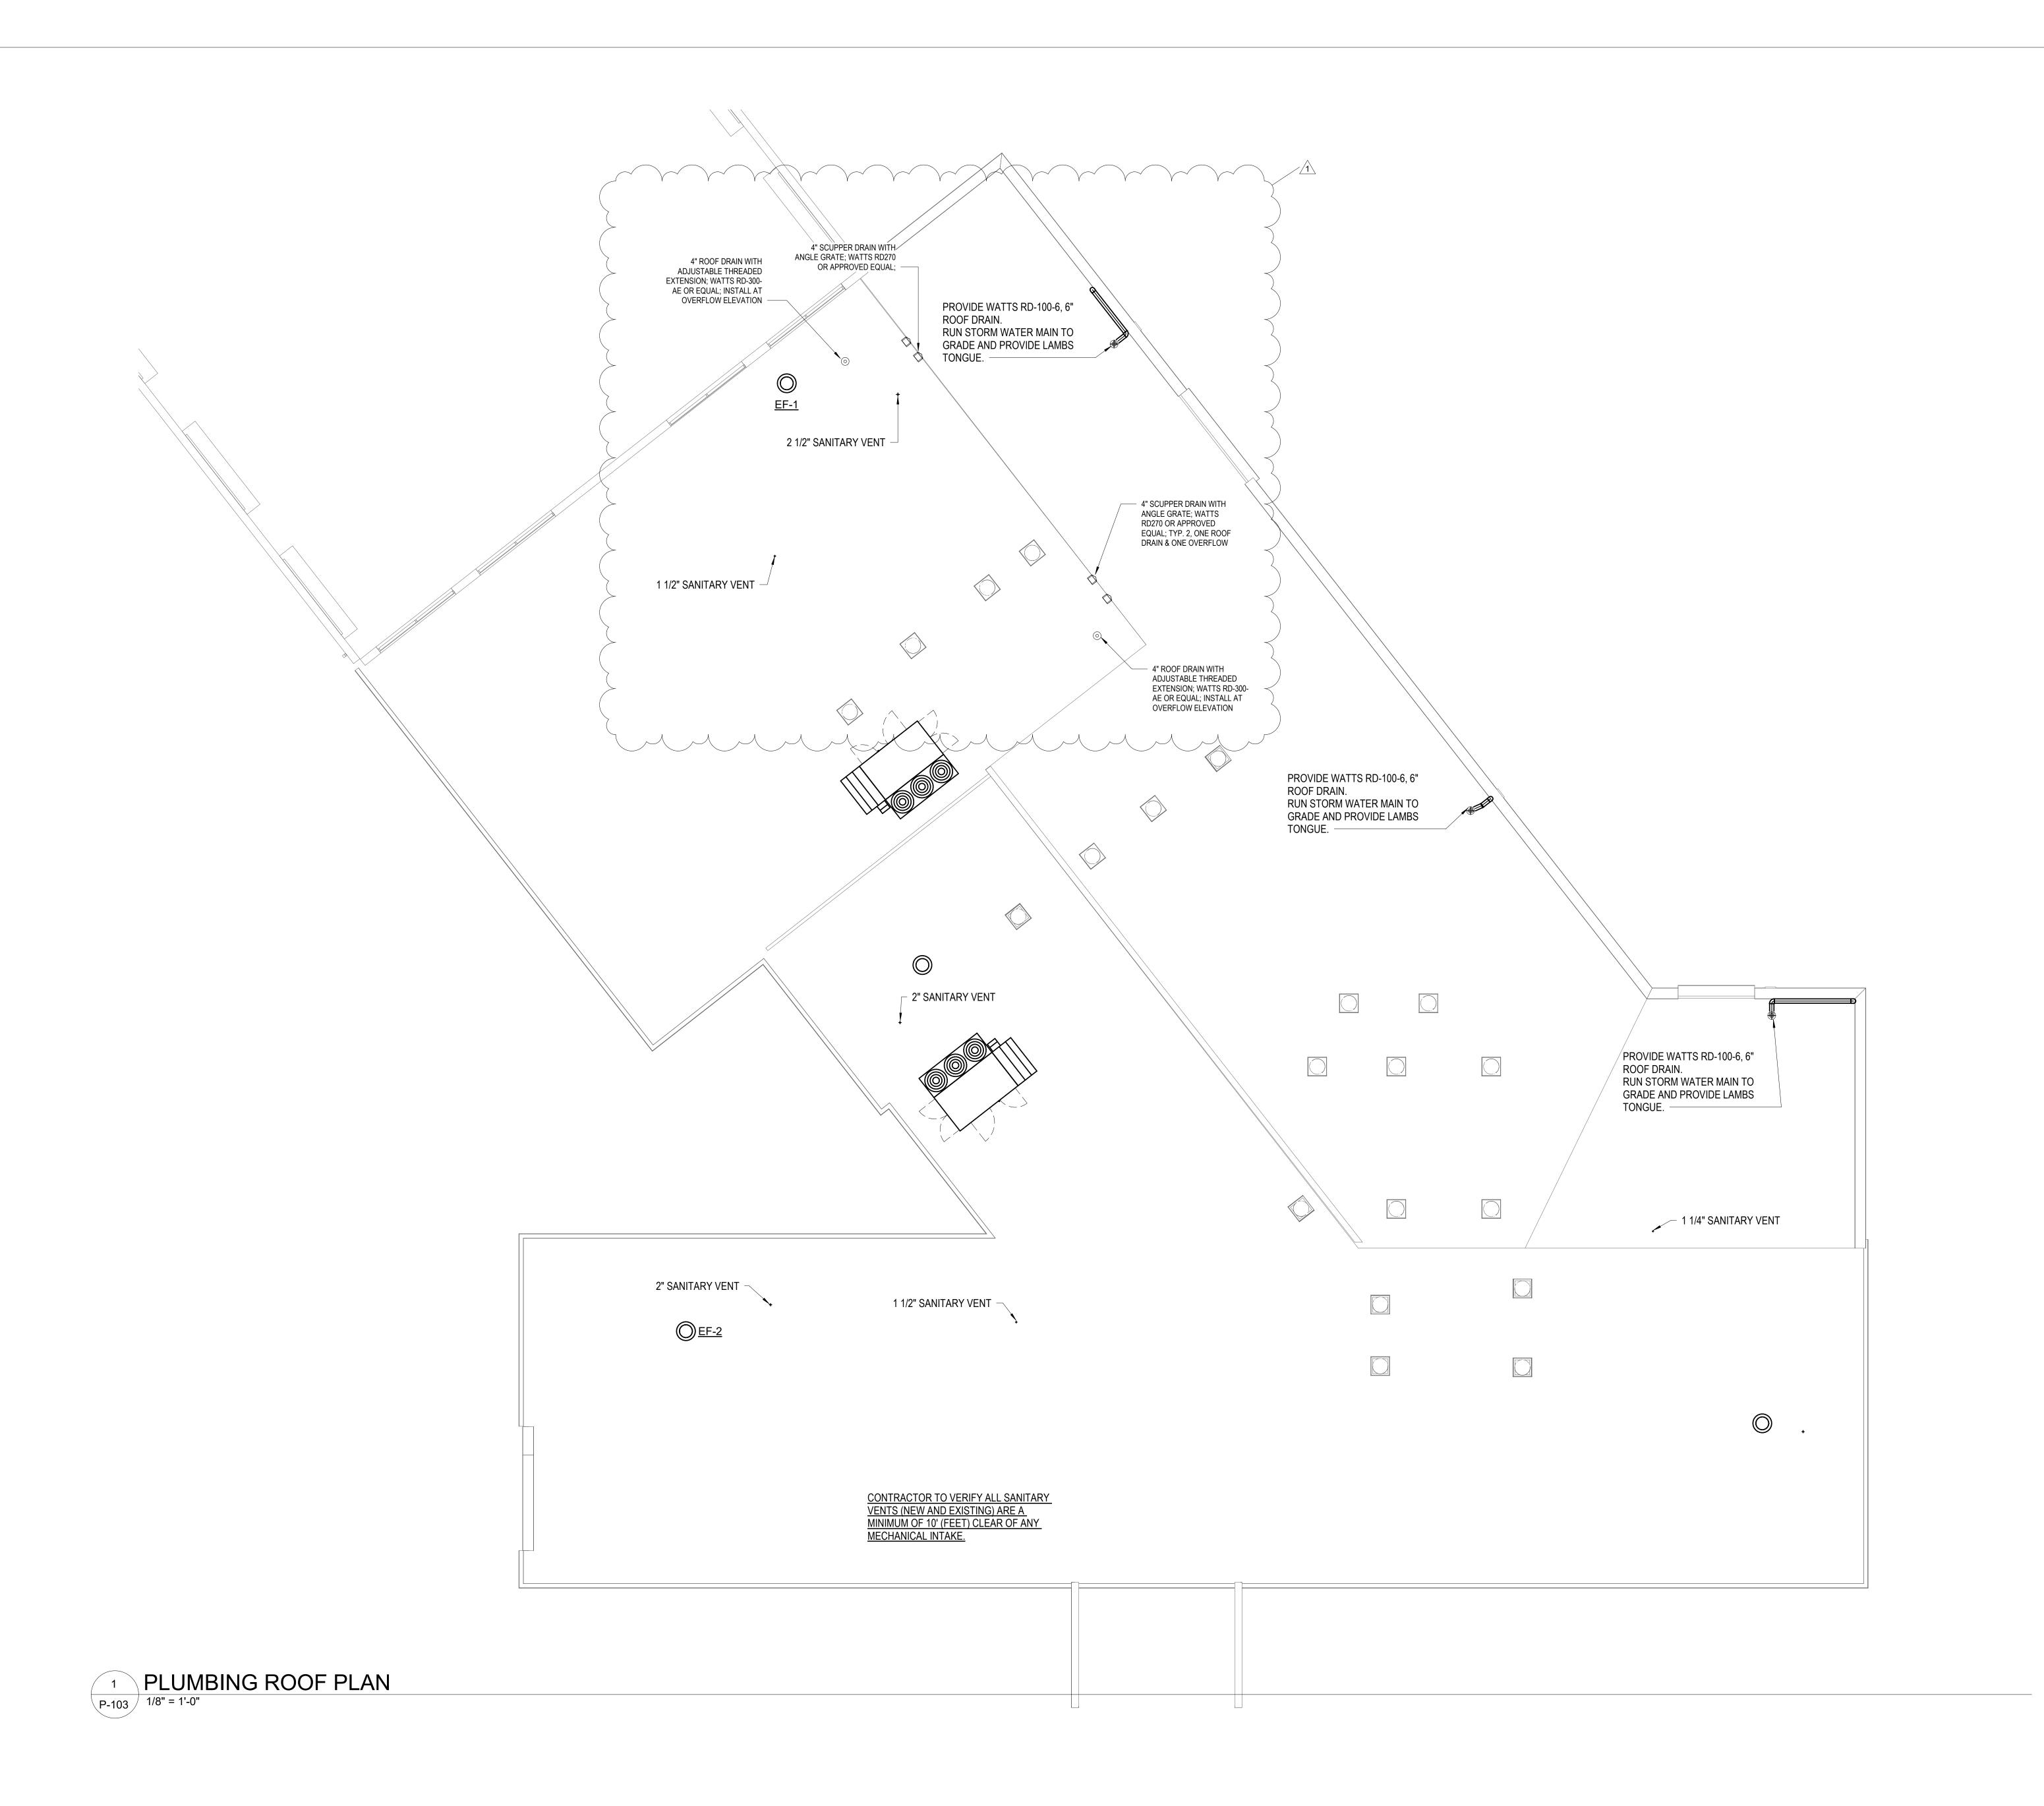

THIS DRAWING IS THE PROPERTY OF <u>STUDIOJAED</u>
AND IS PREPARED FOR THE EXCLUSIVE USE OF
ITS CLIENTS AT THE LOCATION INDICATED. NO
OTHER USE IS AUTHORIZED OR INTENDED. ARCHITECT / ENGINEER SEAL REVISIONS Date Description 11/08/2021 Addendum #5 07/21/2022 ASI-12 PLUMBING ROOF PLAN ISSUED FOR CONSTRUCTION JANUARY 26, 2022

P-103