


ASI No. 8 – Replace Phase 1A Duct Insulation

TO : Conventional Builders
FROM : Dan Shurina
DATE : 01/31/24
REFERENCE : 19121 East Wing HVAC Replacement at DelDOT Admin Bldg

Changes to Scope:

Demolish and replace existing insulation at existing supply and return ducts in OSEC area (area pictured below) which are to remain. New insulation is to be provided per specification.

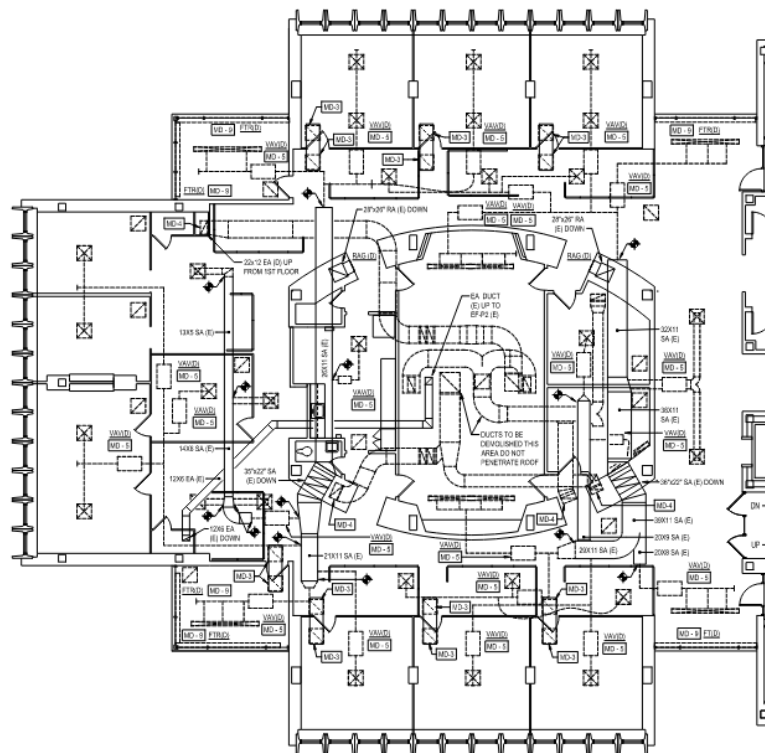

END